


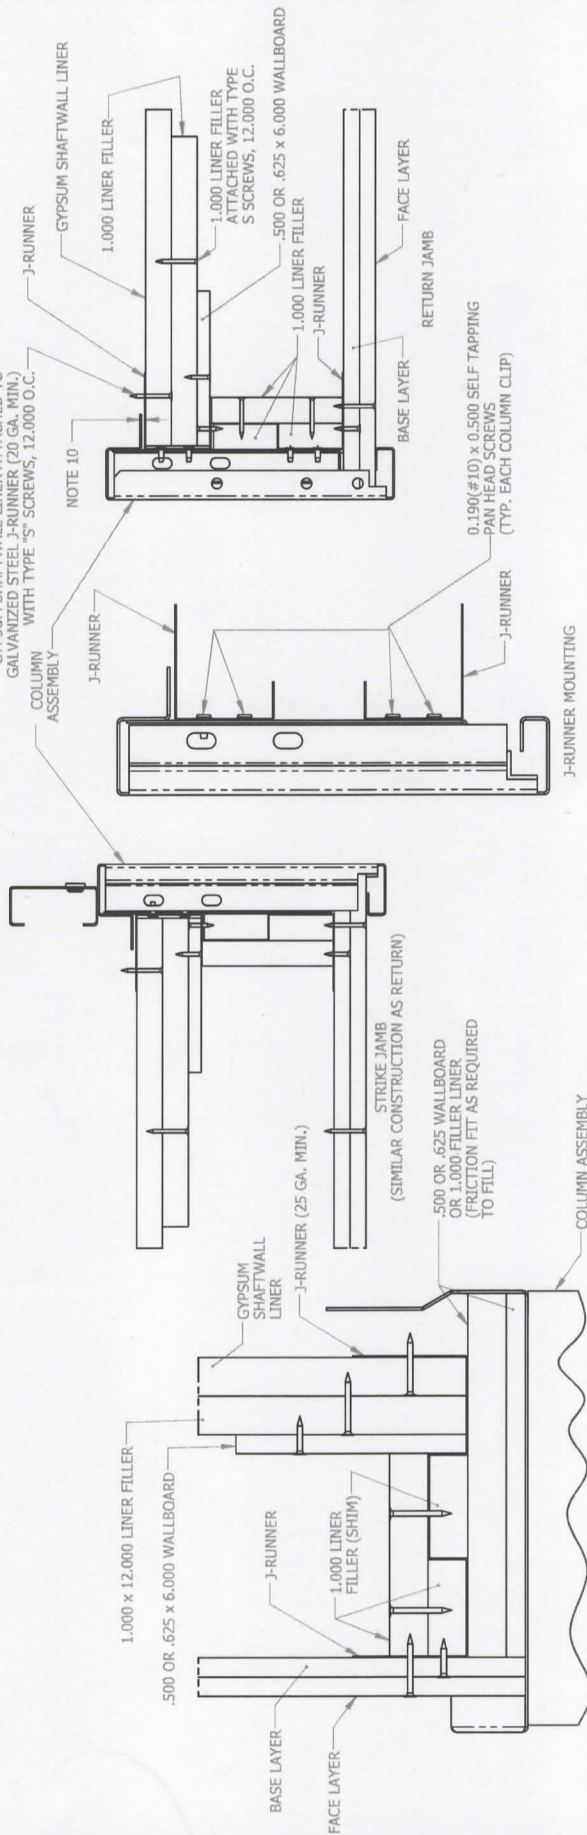

TYPICAL NOTES FOR ALL WALL OPTIONS:

1. UL FIRE RESISTANCE HOISTWAY WALL RATING UP TO 2 HOURS.
FOR ELEVATOR DOOR FRAMING WALL DESIGN AND MATERIAL, REFER TO SPECIFIED UL CONSTRUCTION DETAILS.
2. UNLESS OTHERWISE SPECIFIED, ALL MATERIALS AND LABOR RELATING TO HOISTWAY WALL
3. 4. ENTRANCE LABEL UP TO 2 HOURS MAXIMUM.
AND INSTALLATION ARE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR AND NOT THE
ELEVATOR SUPPLIER. THIS INCLUDES, BUT IS NOT LIMITED TO, STEEL OR WOOD STUDS,
J-RUNNERS, CH STUDS, SHAFTHALL LINER, WALLBOARD LAYERS (TYPE X OR C), FILLERS
AND FASTENERS.
5. THESE DOOR AND FRAME WILL CARRY A 1/2 OR 2 HOUR FIRE LABEL FROM AN APPROVED
TESTING FACILITY WHICH WILL MEET OR EXCEED THE MINIMUM REQUIRED BY THE LOCAL
BUILDING CODE.
6. **FOR CLEAR DOOR OPENING HEIGHTS 7 FEET OR LESS:**
FILLERS AND STRIPS / SHIMS ARE NOT REQUIRED PER SPECIFIED UL CONSTRUCTION
7. FOR CLEAR DOOR OPENING HEIGHTS OVER 7 FEET SHAFTHALL CONSTRUCTION ONLY:
LINER 1,625 TYPE S STEEL SCREWS STAGGERED 12,000 O.C.
LINER 1,625 TYPE S STEEL SCREWS STAGGERED 12,000 O.C.
FILLER STRIPS - ATTACH 500 OR 625 X 6,000 WIDE SHAFTHALL LINER FILLER TO
SHAFTHALL LINER WITH TYPE W STEEL SCREWS STAGGERED 12,000 O.C.
FILL JAMB STRUT WITH HEADER COMPLETELY (WITHIN .188") WITH LAYERS
AND THICKNESS AS REQUIRED TO MEET UL DESIGN.

8. WALL BOARD LAYERS TO BE ATTACHED TO THE JAMB STRUT AND STUD WITH THE FASTENER TYPE, LENGTHS, LOCATION AND SPACING IN ACCORDANCE WITH THE SPECIFIED UL DESIGN (WALL BOARD THICKNESS PER SPECIFIED UL DESIGN). SEE CHART BELOW FOR WALL SYSTEM CONFIGURATION OPTIONS:

GYP-SUM WALL OPTION CHART

OPTION	SHAFT/WALL LINER	GYPSUM WALL OPTION CHART	BASE LAYER	MAXIMUM FIRE RATING
1	1,000 TYPE X	.500 OR .625 TYPE X OR C	.500 OR .625 TYPE X OR C	2 HOUR
2	.750 TYPE X	.625 TYPE X OR C	.625 TYPE X OR C	2 HOUR
3	.500 OR .625 TYPE X OR C (2 LAYERS)	.500 OR .625 TYPE X OR C	.500 OR .625 TYPE X OR C	2 HOUR
4	.625 TYPE X (2 LAYERS)	.625 TYPE X OR C	.625 TYPE X OR C	2 HOUR
5	1,000 TYPE X	.750 TYPE X OR C	N/A	2 HOUR

9. FOR WALLS WITH LESS THAN 2 HOURS RATING, ELIMINATE THE BASE LAYER OPTION.
10. THE SHAFT WALL LINER TO JAMB THROAT GAP TO BE .188 OR LESS. IF LARGER GAP EXISTS, FILL GAP WITH ADDITIONAL WALLBOARD X 6" 0.00" WIDE. ATTACH ADDITIONAL LAYERS TO 3-RUNNER OR STUD USING U1. SPECIFIED STEEL SCREWS 12,000 O.C.

This document contains confidential information proprietary to TK Elevator Americas. It must not be reproduced or disclosed to others or used in any way in whole or in part except as authorized [in writing] by TK Elevator Americas.

[illegible]